


Unit-3

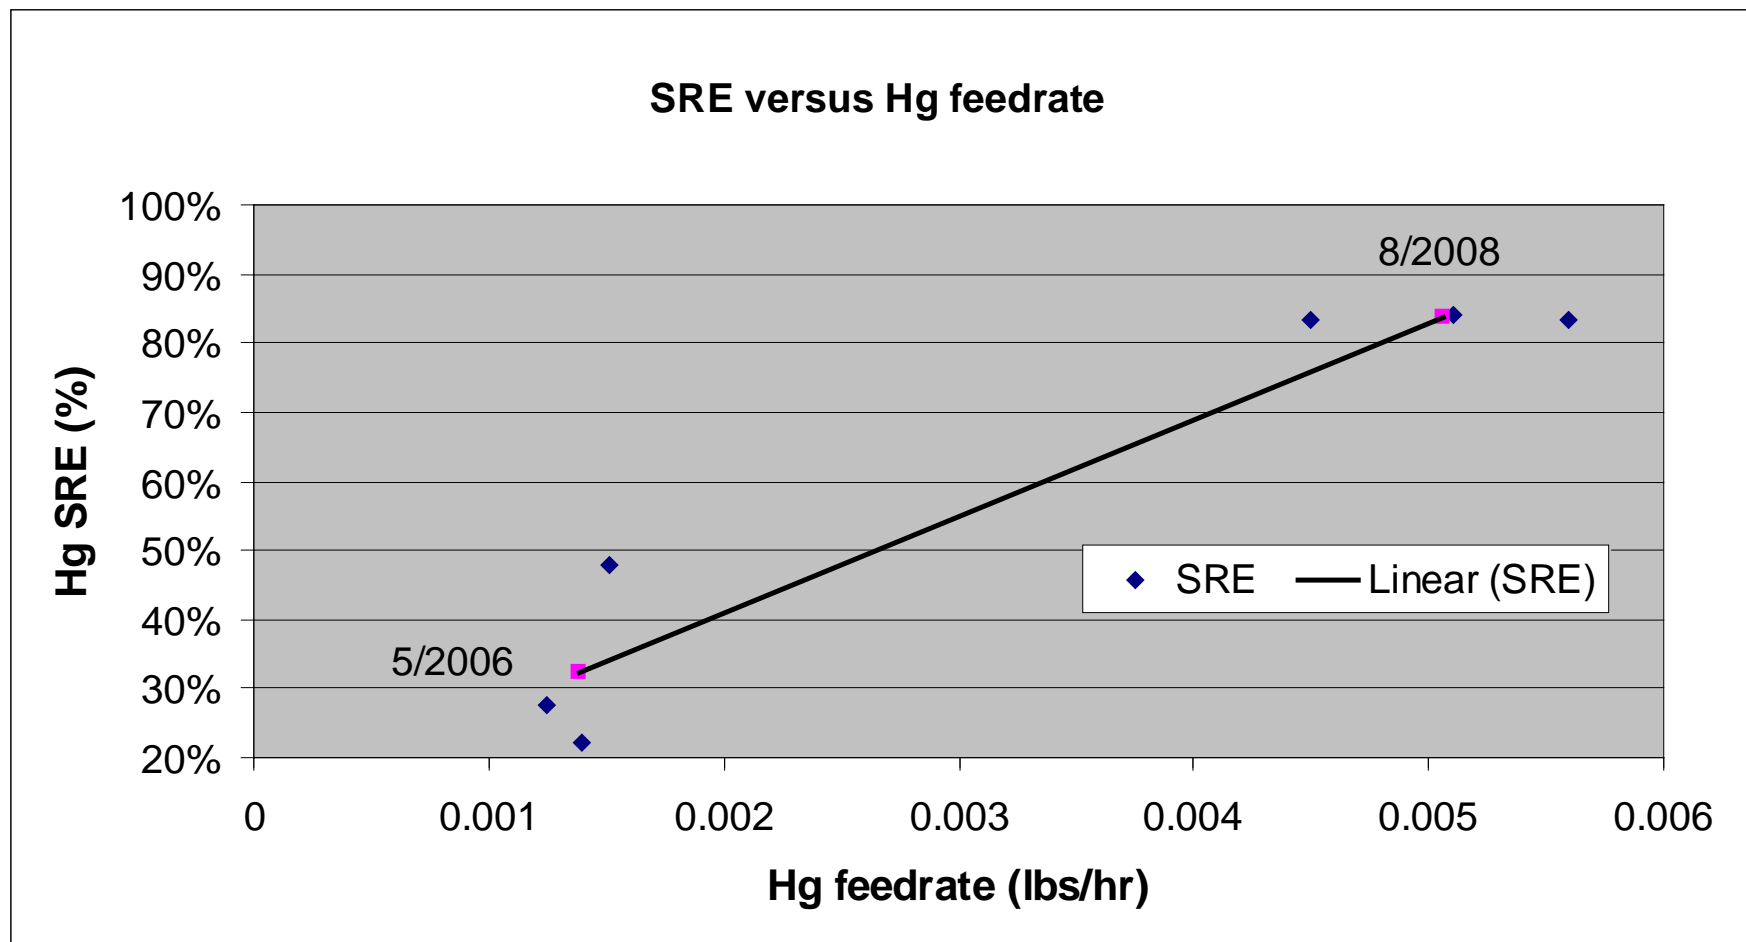

Testing conducted on May, 2006 (pt 1) at the request of the IEPA was to verify the testing conducted on May, 2004 on Unit #2 being used as data in lieu for interim MACT Standard compliance for Unit #3. Testing conducted on August, 2008 (pt 2) was testing conducted as required by June 5, 2008 USEPA letter and to demonstrate compliance with the Final MACT Standards. Pt (2) was conducted at 3.6 times the Mercury feed rate at Pt (1). Pt (2) resulted in higher SRE's.